


Please be aware of building support columns with fire equipment in or around your booth space.  
General booth guidelines can be found here:  
<https://www.namm.org/exhibit/thenammshow/important-guidelines/display-guidelines-rules-regulations>  
NOTE: Fire equipment must be visible and accessible at all times

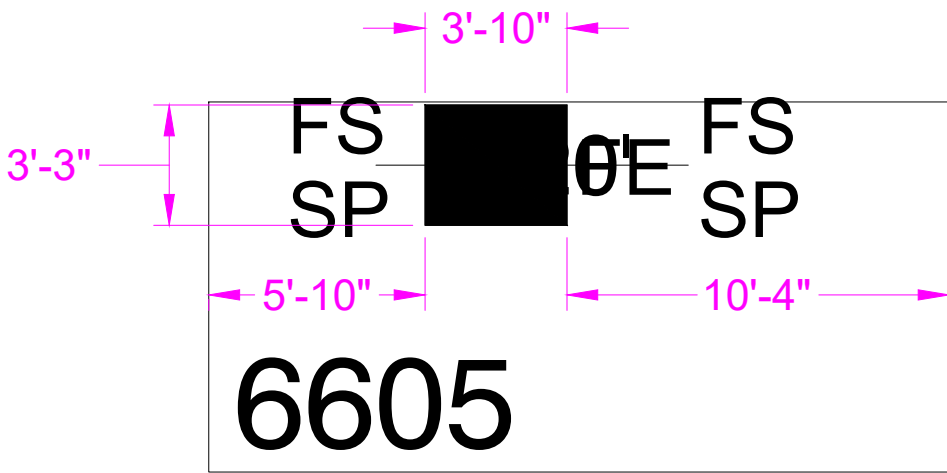

|  |   |
|--|---|
| <p>REFERENCE GUIDELINES (unless otherwise noted on map)</p> <p><u>FS (Fire Strobe)</u>: ACC exhibit hall are 20' height; ACC lobbies are 6'7" height from the floor.</p> <p><u>FE (Fire Extinguisher)</u>: Must remain visible, accessible and unobstructed</p> <p><u>SP (Fire Speaker)</u>: 6"x6" &amp; located at 9'9" height from the floor and shall be visible and unobstructed</p> <p><u>FHC (Fire Hose Connection)</u>: Must remain visible, accessible and unobstructed FDR (Facility Door Release): Must not be blocked</p> | <div><div></div>Building Support Column</div> <p>Exhibitors are free to brand &amp; build around columns, as long as fire equipment is clear and nothing is adhered to the column or physical building.</p> |
|--|---|

- PLEASE NOTE:
- This diagram indicates the size and approximate position of the obstruction within the booth with measurements. This may vary slightly onsite once the floor has been marked
  - All fire equipment on columns must remain visible and accessible at all times and fire hoses must be clear to the aisle.
  - Fire alarm devices have a strobe and a speaker at two different heights on a column
  - Materials may not be affixed to columns; damage will be billed back to the exhibitor by the Anaheim Convention Center.